


# FG27P1/FG30E1



Output Ratings				
Generating Set Model	FG27P1/FG30E1			
	LPG		Nat Gas	
	Prime*	Standby*	Prime*	Standby*
380 – 415V, 50 Hz	27.0 kVA	30.0 kVA	27.0 kVA	30.0 kVA
	21.6 kW	24.0 kW	21.6 kW	24.0 kW
480V, 60 Hz	33.8 kVA	37.5 kVA	33.8 kVA	37.5 kVA
	27.0 kW	30.0 kW	27.0 kW	30.0 kW

\* Refer to ratings definitions on page 4.  
Ratings at 0.8 pf

Technical Data		
Engine Make & Model	Ford ESG 642	
Alternator Model	LL1014S	
Base Frame Type	Heavy Duty Fabricated Steel	
Circuit Breaker Type/Rating	3 Pole MCCB	
Frequency	50 Hz	60 Hz
Engine Speed	1500	1800
Fuel Consump m <sup>3</sup> /hr (cfh) LPG	4.0 (139)	4.7 (164)
Fuel Consump m <sup>3</sup> /hr (cfh) NG	10.8 (380)	12.9 (454)

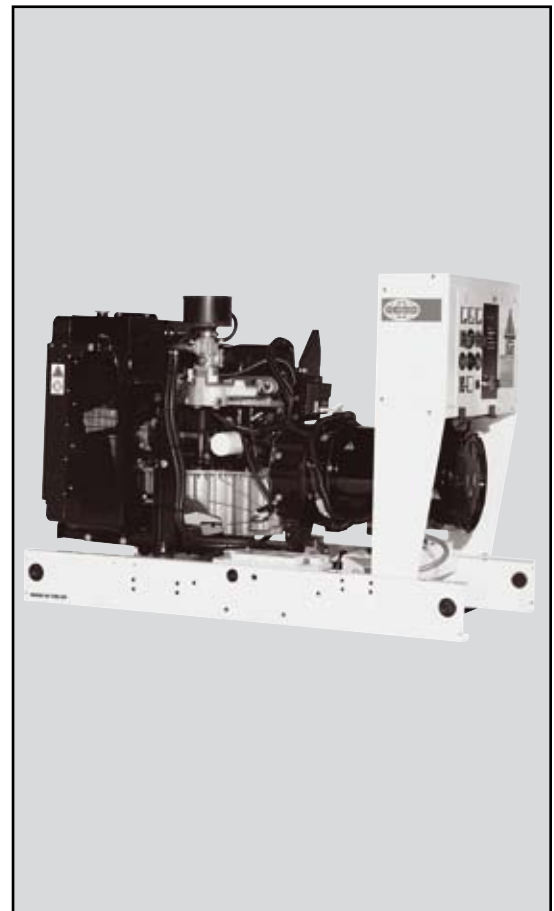

## Weights & Dimensions

Weights: kg (lbs)		Dimensions: mm (in)	
Wet (+ lube oil & coolant)	637 (1401)	Length	2165 (86.6)
		Width	890 (35.6)
		Height	1239 (49.6)



FG Wilson has manufacturing facilities in the following locations:

Northern Ireland • Brazil • China • India • USA

With headquarters in Northern Ireland, FG Wilson operates through a Global Dealer Network. To contact your local Sales Office please visit the FG Wilson website at

[www.FGWilson.com](http://www.FGWilson.com)





## Alternator Performance Data

Data Item	50 Hz				60 Hz				
	415/240	400/230 230/115 200/115	380/220 220/110	220/127	480/227 240/139	380/220 220/110	240/120 208/120	230/115	220/127 440/254
<b>Motor Starting Capability* kVA</b>	62	58	51	69	68	44	52	48	58
<b>Short Circuit Capacity** %</b>	300	300	300	300	300	300	300	300	300
<b>Reactances: Per Unit</b>									
<b>X<sub>d</sub></b>	1.83	1.97	2.19	1.48	1.83	2.92	2.43	2.63	2.17
<b>X'<sub>d</sub></b>	0.1	0.11	0.12	0.08	0.1	0.16	0.13	0.15	0.12
<b>X''<sub>d</sub></b>	0.051	0.055	0.06	0.041	0.05	0.081	0.067	0.073	0.06

Reactances shown are applicable to prime ratings

\* Based on 30% voltage dip. Improved motor starting is available with optional AREP excitation

\*\* With optional AREP excitation

## Alternator Technical Data

Physical Data		Operating Data	
<b>Manufacturer:</b>	FG Wilson	<b>Overspeed: RPM</b>	2250
<b>Model:</b>	LL1014S	<b>Voltage Regulation (steady state)</b>	+/- 0.5%
<b>No. of Bearings:</b>	1	<b>Wave Form NEMA =TIF</b>	<50
<b>Insulation Class:</b>	H	<b>Wave Form IEC=THF</b>	<2%
<b>Winding Pitch Code:</b>	2/3 (No. 6)	<b>Total Harmonic Content LL/LN</b>	<4%
<b>Wires:</b>	12	<b>Radio Interference</b>	Suppression is in line with British Standard BSEN50081 and BSEN50082
<b>Ingress Protection Rating:</b>	IP23	<b>Radiant Heat: kW (Btu/min)</b>	
<b>Excitation System:</b>	SHUNT	-50 Hz:	3.4 (193)
<b>AVR Model:</b>	R230	-60 Hz:	4.0 (228)

## Technical Data

### 3 Phase Ratings and Performance at 50 Hz, 1500 RPM

### 3 Phase Ratings and Performance at 60 Hz, 1800 RPM

Voltage	Model: FG27P1 Prime		Model: FG30E1 Standby		Voltage	Model: FG27P1 Prime		Model: FG30E1 Standby	
	kVA	kW	kVA	kW		kVA	kW	kVA	kW
415/240	27.0	21.6	30.0	24.0	480/277	33.8	27.0	37.5	30.0
400/230	27.0	21.6	30.0	24.0	440/254	33.8	27.0	37.5	30.0
380/220	27.0	21.6	30.0	24.0	380/220	33.0	26.4	36.5	29.2
230/115	27.0	21.6	30.0	24.0	240/139	33.8	27.0	37.5	30.0
220/127	25.0	20.0	27.0	21.6	240/120	33.8	27.0	37.5	30.0
220/110	27.0	21.6	30.0	24.0	230/115	33.8	27.0	37.5	30.0
200/115	27.0	21.6	30.0	24.0	220/127	33.8	27.0	37.5	30.0
					220/110	33.0	26.4	36.5	29.2
					208/120	33.8	27.0	37.7	30.0

These ratings are based on generating set performance using LPG fuel.

## Definitions

### Standby Rating

These ratings are applicable for supplying continuous electrical power (at variable load) in the event of a utility power failure. No overload is permitted on these ratings. The alternator on this model is peak continuous rated (as defined in ISO8528-3).

### Prime Rating

These ratings are applicable for supplying continuous electrical power (at variable load) in lieu of commercially purchased power. There is no limitation to the annual hours of operation and this model can supply 10% overload power for 1 hour in 12 hours.

### Standard Reference Conditions

Ratings in accordance with ISO8528. All engine performance data based on the above mentioned maximum continuous ratings. Fuel Consumption data assumes complete combustion of LPG fuel with a calorific value of 95MJ/m<sup>3</sup> and of Natural gas with a calorific value of 34.4MJ/m<sup>3</sup>.

## General Data

### Documents

A full set of operation and maintenance manuals, circuit wiring diagrams, and commissioning/fault finding instruction leaflets.

### Generating Set Standards

The equipment meets the following standards: BS5000, ISO 8528, ISO 3046, IEC 60034, VDE 0530, NEMA MG-1.22.

FG Wilson is a fully accredited ISO9001 company.

### Warranty

All equipment carries full manufacturer's warranty. Extended warranty terms available. For details on warranty cover please contact your local dealer, or visit our website, [www.FGWilson.com](http://www.FGWilson.com)

