

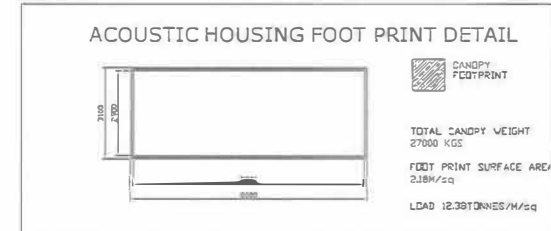


THIS DRAWING IS FOR INFORMATIONAL PURPOSES ONLY AND MAY BE CHANGED WITHOUT NOTICE

ESTIMATED WEIGHT 27000 KGS

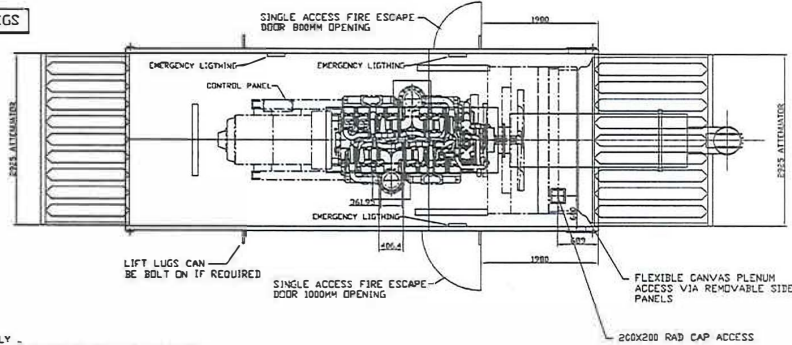


ELECTRICAL SUPPLY -
 1 x CONSUMER UNIT WITH 63A / 30mA RCD PROTECTION
 3 x 1200LG 240V FLUORESCENT FITTINGS
 2 x 12V DC EMERGENCY LIGHT FITTINGS
 2 x 2 WAY 240V LIGHT SWITCHES
 1 x TWIN 240V ISAMP SOCKET
 1 x CONVERTOR HEATER WITH THERMOSTAT
 ALL CONDUIT 20mm GALV
 TO CONFORM WITH IEG REGULATIONS

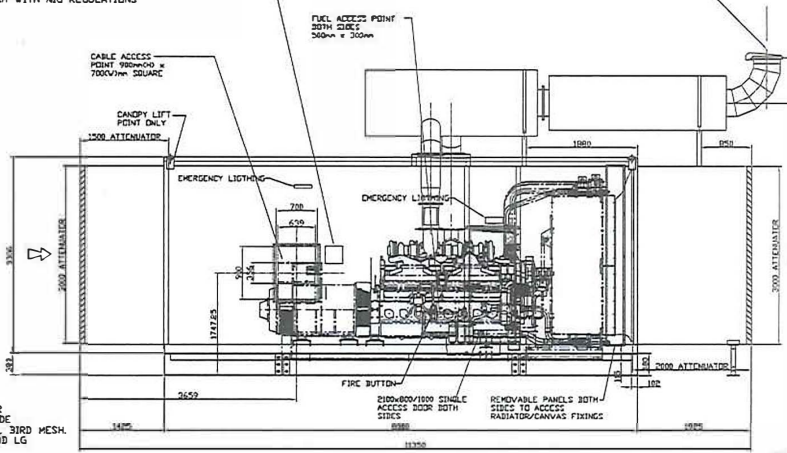

EXHAUST SILENCER SYSTEM TO COMPRISE -
 160mm NB HAZ/75c WITH 150mm NB TPI INTERNAL PIPE WORK FROM ENGINE BELLOWS TO EXHAUST OUTLET PLATE TO BE 120mm NB AND BE LAGGED

FLANGED PIPE WORK BETWEEN ENGINE BELLOWS & CANDOPY OUTLET BOX IN ROOF - LAGGED

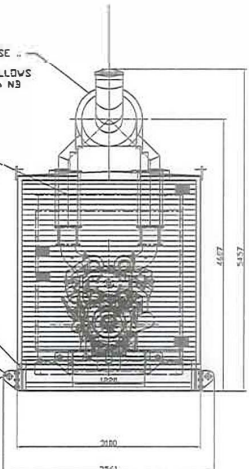

ACOUSTIC CANDOPY SPECIFICATION -
 15 THK ZINTEG OUTER SKIN
 75 THK MIN. FIBRE (45 KGS/M3)
 10 THK GALVANISED PERFORATED SHEET
 BASE CHANNEL - 150x75x18A PFC
 LIFT LUGS - CANDOPY LIFT ONLY FITTINGS
 PLATED FLUSH FURGGCAR WITH GREASE NIPPLE
 K29 LOCKING SLAM WITH INTERNAL PUSH-RODS
 PLATED SPRUNG DROP BOLT,
 PLATED TOP BOX DOOR STAY
 EST WEIGHT - TBC KGS
 FINISH - GLOSS TO BS4000 COLOUR TO BE ADVISED
 LODGE ITEM - 10x6THK SELF ADHESIVE NEOPRENE BASE SEAL 20 METRES

DIMENSIONS IN MM UNLESS OTHERWISE STATED

REV. No.	DESCRIPTION	CHK'D	DATE
8	CHANGE FUEL INLET TO INFRONT OF DOOR	KAS	23/11/09
7	CHANGE DOORS TO OTHER SIDE AS PER LATEST SITE DRAWING	KAS	16/11/09
6	REMOVE FUEL HATCH SIDE A TELEPHONE CALL D BUTTER	KAS	05/11/09
5	CHANGES FROM TELEPHONE CALL D BUTTER	KAS	03/11/09
4	CHANGES FROM TELEPHONE CALL O BUTTER	KAS	29/10/09
3	CHANGES TO LATEST PLANT ARRANGEMENT 6420-EG-SK02	KAS	29/10/09
2	CHANGES TO WB EMAIL 26/10/09	KAS	26/10/09
1	FOR CUSTOMER CHECK AND ADVSE UNOEFINED DIMENSIONS	KAS	26/10/09

TITLE:
ACOUSTIC HOUSING TO SUIT CUMMINS QSK60G4 GENERATOR TO ACHIEVE 75 dBA @ 1 METRE

DRAWN BY:
KAS
 DATE
03/11/09
 SCALE
NTS
 DRAWING No.
024499-OL

